17A

City of Panama City Infrastructure Study

Figure 3

WATER SYSTEM
Future GDSA Developments
(No System Improvements)

Level of Service

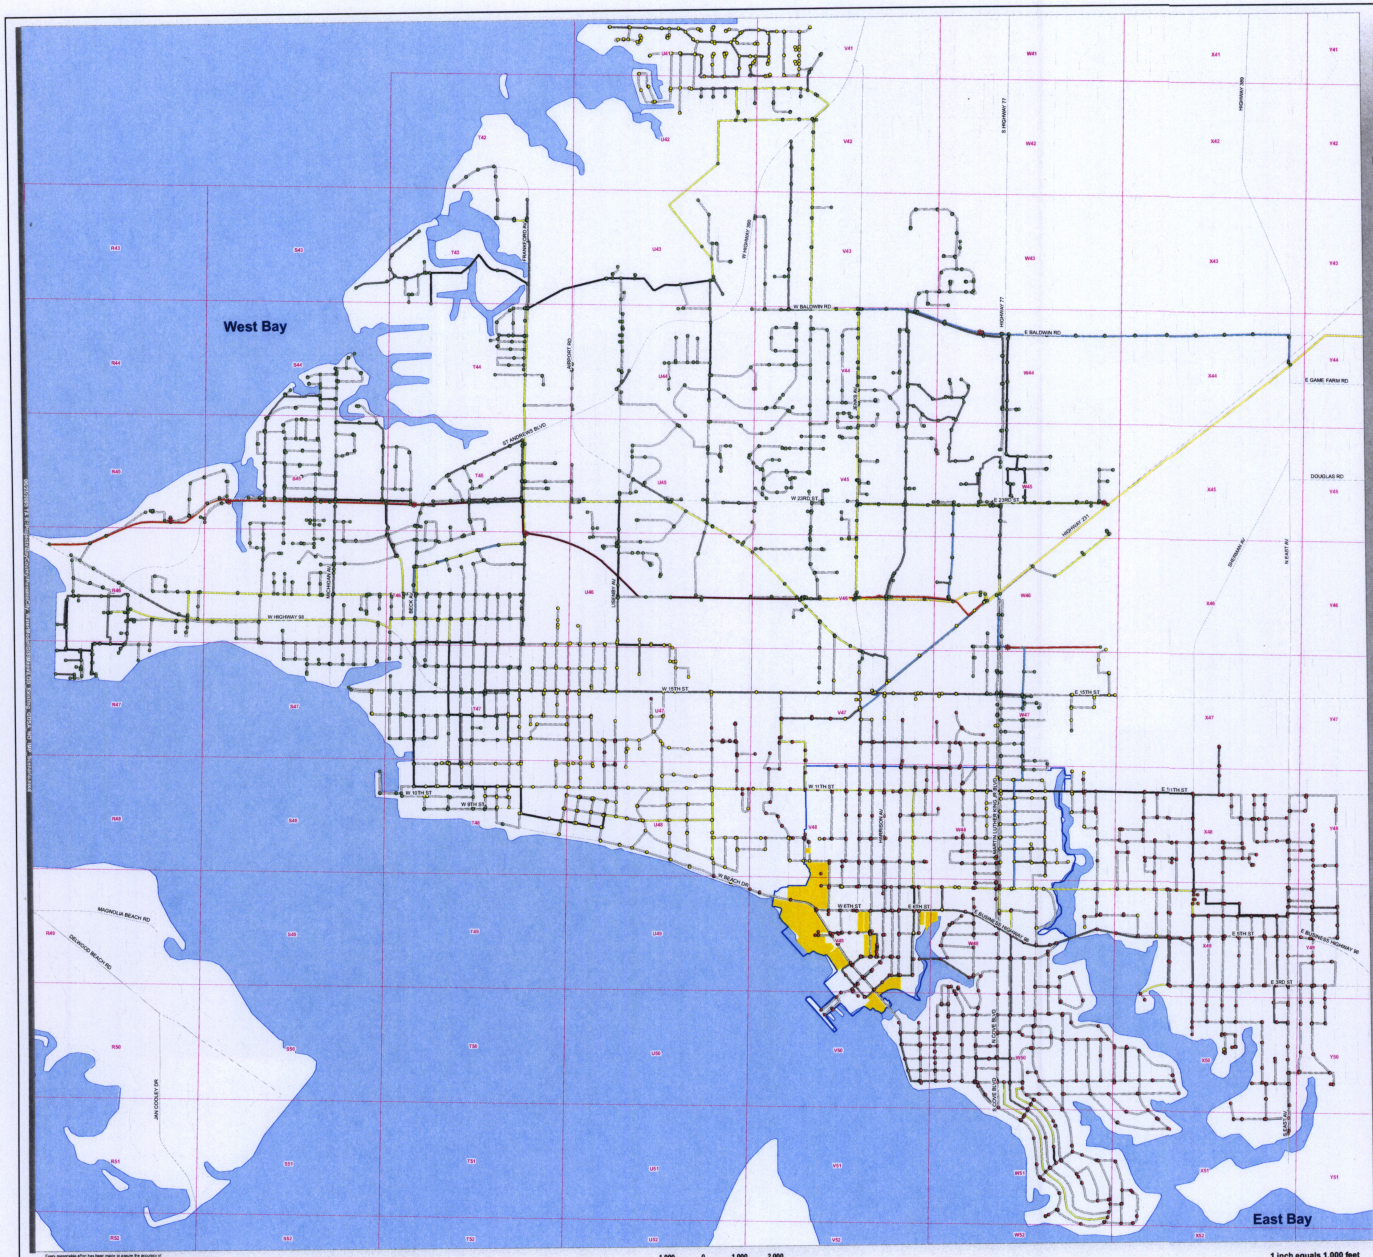

Legend

- Water Wholesale Active Meters

Junction

- D: Less than 20 psi
- C: 20~30 psi
- B: 30~40 psi
- A: Greater than 40 psi
- Panama City Grid
- CRA Boundary
- Projected Growth

Pipe Diameter

- 6
- 8
- 10
- 12
- 14
- 16
- 20
- 24
- 30
- Major Streets
- Minor Streets



PBSJ

1 inch equals 1,000 feet

June 23, 2005

Every reasonable effort has been made to assure the accuracy of this map. However, neither PBSJ nor the City of Panama City assume liability arising from its use.
THE MAP IS PROVIDED "AS IS" WITHOUT WARRANTY OF ANY KIND, EITHER EXPRESSED OR IMPLIED.